



Test Report No. 38/06

Laboratory Measurement of Airborne Sound Insulation according to ČSN EN ISO 140-3

Item tested: Fire resistant glass Pyrobelt EI 45/17 EG

Contract No: 663 653

Number of pages: 4

Number of copies: 4

Copy No.: 4

Customer: **IKATES, s.r.o., Tolstého 186, 415 03 Teplice**

Producer: **Glaverbel Czech a.s., Sklářská 450, 416 74 Teplice**
Glaverbel Oloví plant

Sample accepted on: 16 December 2005

Tested on: 8 February 2006

Tested by the Building Acoustics Laboratory

Head of laboratory: Ing. Miroslav Figalla

Head of testing laboratory No. 1007.1:

Ing. Miroslav Figalla

.....


The Accredited Testing Laboratory hereby declares that test results cover the tested object only and does not imply approval or certification of the tested product. Without a written consent by the Testing Laboratory, the Test Report may not be reproduced otherwise than in full.

Date: 14 February 2006



1. Test Job

The test has been performed on the basis of the order of January 11, 2006, contract No. 663 653.

2. Subject of Test

Determination of airborne sound insulation based on laboratory measurement results obtained by an engineering method. Conclusive tests.

Element tested: Fire resistant glass Pyrobel EI 45/17 EG, laminated glass of thickness overall 20 mm. Code designation of structure: 2/2/3/2/2:2,

where digit means the thickness of float glass,

/ fire resistant silicate layer,

: PVB foil.

Producer: Glaverbel Czech a.s., Sklářská 450, 416 74 Teplice, Glaverbel Oloví plant.

3. Test Sample

The Producer supplied a testing sample, dimensions 1,200 x 1,500 mm, on December 16, 2005. The sample was installed into a measuring hole for vertical elements. Installation of the sample was performed by the staff of the testing laboratory.

4. Standards used and measuring equipment

4.1 Standards

- ČSN EN ISO 140-3. Acoustics – Measurement of sound insulation in buildings and of building elements. Part 3: Laboratory measurement of airborne sound insulation of building elements,
- ČSN EN ISO 717-1 Acoustics. Rating of sound insulation in buildings and of building elements. Part 1: Airborne sound insulation.

Related standards:

- ČSN EN 20140-2 Acoustics – Measurement of sound insulation in buildings and of building elements. Part 2: Determination, verification and application of precision data.
- ČSN 73 0532 Acoustics – Sound protection in buildings and related acoustic properties of building elements - Requirements.

4.2 Measuring equipment

- Norsonic RTA 840 analyzer M 07 2024
- B. K. measuring microphone M 07 2005

5. Testing Procedure

Measuring is performed in sound chambers meeting the requirements of the ČSN ISO 140-1 standard. The tested element is mounted between the source and receiving room into a measuring opening for vertical elements. A steady sound is generated in the source room with continuous spectrum in the 100 to 5000 Hz band. Mean sound levels of acoustic pressure are measured in the source and receiving room (in dB). Sound reduction index is determined by the relation

$$R = L_1 - L_2 + 10 \log \frac{S}{A} \quad (\text{dB}),$$

where L_1 is the average sound pressure level in the source room,

L_2 .. average sound pressure level in the receiving room,
 S ... area of the test specimen in m^2 ,
 A ... equivalent absorption area in the receiving room in m^2 .

The size of the equivalent absorption area is determined from reverberation time measured according to the ČSN ISO 354 standard using the Sabine's formula

$$A = \frac{0,16 V}{T}$$

where V is the volume of the receiving room in m^3 ,
 T ... reverberation time in the receiving room in seconds.

A single digit quantity, weighted sound reduction index R_w is determined from the values of sound reduction index R in third-octave bands 100 to 3150 Hz, using the reference curve and method according to ČSN EN ISO 717-1.

6. Deviations from standard testing methods

7. Non-standardized methods employed

8. Test Results

Weighted sound reduction index of measured fire resistant glass Pyrobel EI 45/17 EG:

$$R_w (C; C_{tr}) = 38 (0; -3) \text{ dB.}$$

The course of sound insulation depend on the frequency and further measurement data are shown in standard measuring record on p. 4.

9. Measurement Uncertainty

Measurement uncertainty is to be expressed in accordance with ČSN EN 20140-2 using the indices of repeatability r and reproducibility R that are the values under which the absolute value of the difference of the results of tests performed under specified conditions will lie with the probability of 95 %. For a single-digit quantity R_w , the repeatability index $r = 1$ dB, the reproducibility index $R = 2$ dB.

In charge for the test: Ing. Miroslav Figalla

**Laboratory measurements of airborne sound insulation
of building elements according to ČSN EN ISO 140-3**

 Reg. No.
26/06


 Customer:
IKATES, s.r.o.
Tolstého 186
415 03 Teplice

 Item: Fire resistant glass
Test date: 08.02.2006
Temperature: 18 °C
Humidity: 38 %

Sample description: Fire resistant glass Pyrobel EI 45/17 EG, laminated glass of thickness overall 20 mm. Code designation of structure: 2/2/3/2/2:2, where digit means the thickness of float glass, / fire resistant silicate layer, : PVB foil.

 Producer: Glaverbel Czech a.s., Sklářská 450, 416 74 Teplice, Glaverbel Oloví plant.
Mass per unit: 48,1 kg/m².
Sample No.: 193/A/05.

Freq. Hz	R 1/3 oct. dB
100	32,2
125	30,1
160	31,7
200	30,3
250	30,2
315	32,0
400	31,4
500	32,0
630	33,2
800	35,7
1000	38,9
1250	41,6
1600	44,3
2000	47,7
2500	49,7
3150	52,0
4000	54,4
5000	56,3

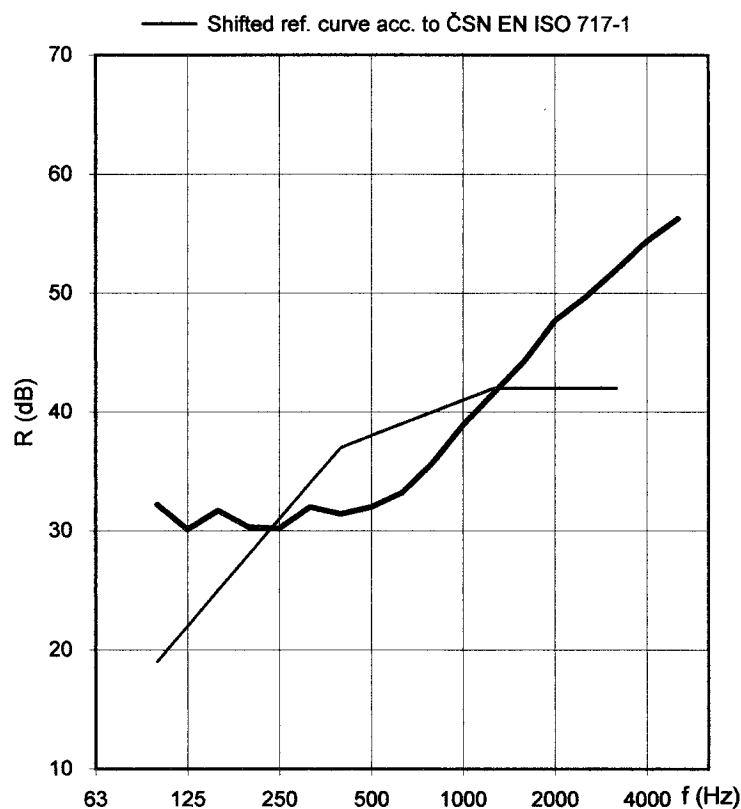

Rating according to ČSN EN ISO 717-1:

 $R_w (C; C_{tr}) = 38 (0; -3) \text{ dB}$

 Size: 1,8 m²
Source room volume: 90 m³
Receiving room volume: 70 m³

 Centrum stavebního inženýrství, a.s. Praha (Centre of Building
Construction Engineering, joint-stock company, Prague), workplace Zlín

Date: 14 February 2006

Signature: